

CLEAN AIR ACT, 1956
(as amended)

NEWARK AND SHERWOOD DISTRICT COUNCIL (No. 8)
SMOKE CONTROL ORDER 1987

The Council for the District of Newark and Sherwood in exercise of the powers conferred upon them by Section 11 of the Clean Air Act, 1956 (as amended) hereby make the following Order:-

1. This Order may be cited as "The Newark and Sherwood District Council (No. 8) Smoke Control Order 1987".
2. The area which is coloured green on the map, prepared in duplicate, sealed with the Common Seal of the said Newark and Sherwood District Council and marked "Map referred to in the Newark and Sherwood District Council (No. 8) Smoke Control Order 1987," is hereby declared to be a smoke control area. One duplicate of the map is deposited in the Offices of the said Newark and Sherwood District Council and the other is deposited in the Offices of the Secretary of State for the Environment.
3. The fireplaces and classes of fireplaces in the area which are specified in the Schedule hereto, shall be exempted from the operation of the said Section 11 upon the conditions specified in respect thereof in the said Schedule.
4. This Order shall come into operation on the First day of October, One thousand Nine hundred and Eighty-eight.

I N W I T N E S S whereof the Council has caused its Common Seal to be hereunto affixed this Twelfth day of October 1987

SCHEDULE

Fireplaces

Description	Conditions
<p>Nottinghamshire County Council St. Mary's School, Paddock Close, Edwinstowe.</p> <p>1. Trianco Redfyre gravity fed boiler using anthracite beans.</p>	<p>No fuel shall be used other than that for which the mechanical stoker was designed. The fireplace shall be so installed, maintained and operated so as to minimise the emission of smoke and in accordance with the manufacturers' instructions as to operation.</p>
<p>British Coal, Sampler Department, Church Street, Edwinstowe.</p> <p>1. Robin Hood F3 boiler with underfeed stoker using washed singles. Ashwell and Scott Stoker.</p>	<p>No fuel shall be used other than that for which the mechanical stoker was designed. The fireplace shall be so installed, maintained and operated so as to minimise the emission of smoke and in accordance with the manufacturers' instructions as to operation.</p>
<p>British Coal, Records Department, Church Street, Edwinstowe.</p> <p>1. Beeston Robin Hood senior boiler with underfeed stoker using washed singles, Ashwell and Scott stoker.</p>	<p>No fuel shall be used other than that for which the mechanical stoker was designed. The fireplace shall be so installed, maintained and operated so as to minimise the emission of smoke and in accordance with the manufacturers' instructions as to operation.</p>
<p>British Coal, Method Study and Youth Club, Church Street, Edwinstowe.</p> <p>1. Britannia Boiler gravity fed from hopper using washed singles.</p>	<p>No fuel shall be used other than that for which the mechanical stoker was designed. The fireplace shall be so installed, maintained and operated so as to minimise the emission of smoke and in accordance with the manufacturers' instructions as to operation.</p>

CLASS OF FIREPLACE

Description	Conditions
Fireplaces in buildings or parts of buildings separately occupied without gas supply other than those in respect of which grant is subsequently paid for the provisions of means of smokeless ignition.	Only authorised fuels, as declared by regulations under the Clean Air Act, 1956, and kindling sticks and paper shall be used in the fireplaces

The COMMON SEAL of the)
NEWARK AND SHERWOOD)
DISTRICT COUNCIL was)
hereunto affixed in)
the presence of:-)





A handwritten signature in black ink, appearing to be "R. S. D.", written over a faint horizontal line.

Director of Administration.

Map referred to in the Newark and Sherwood District Council
(No. 8) Smoke Control Order 1987

Director of Administration

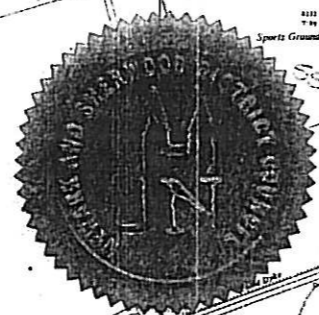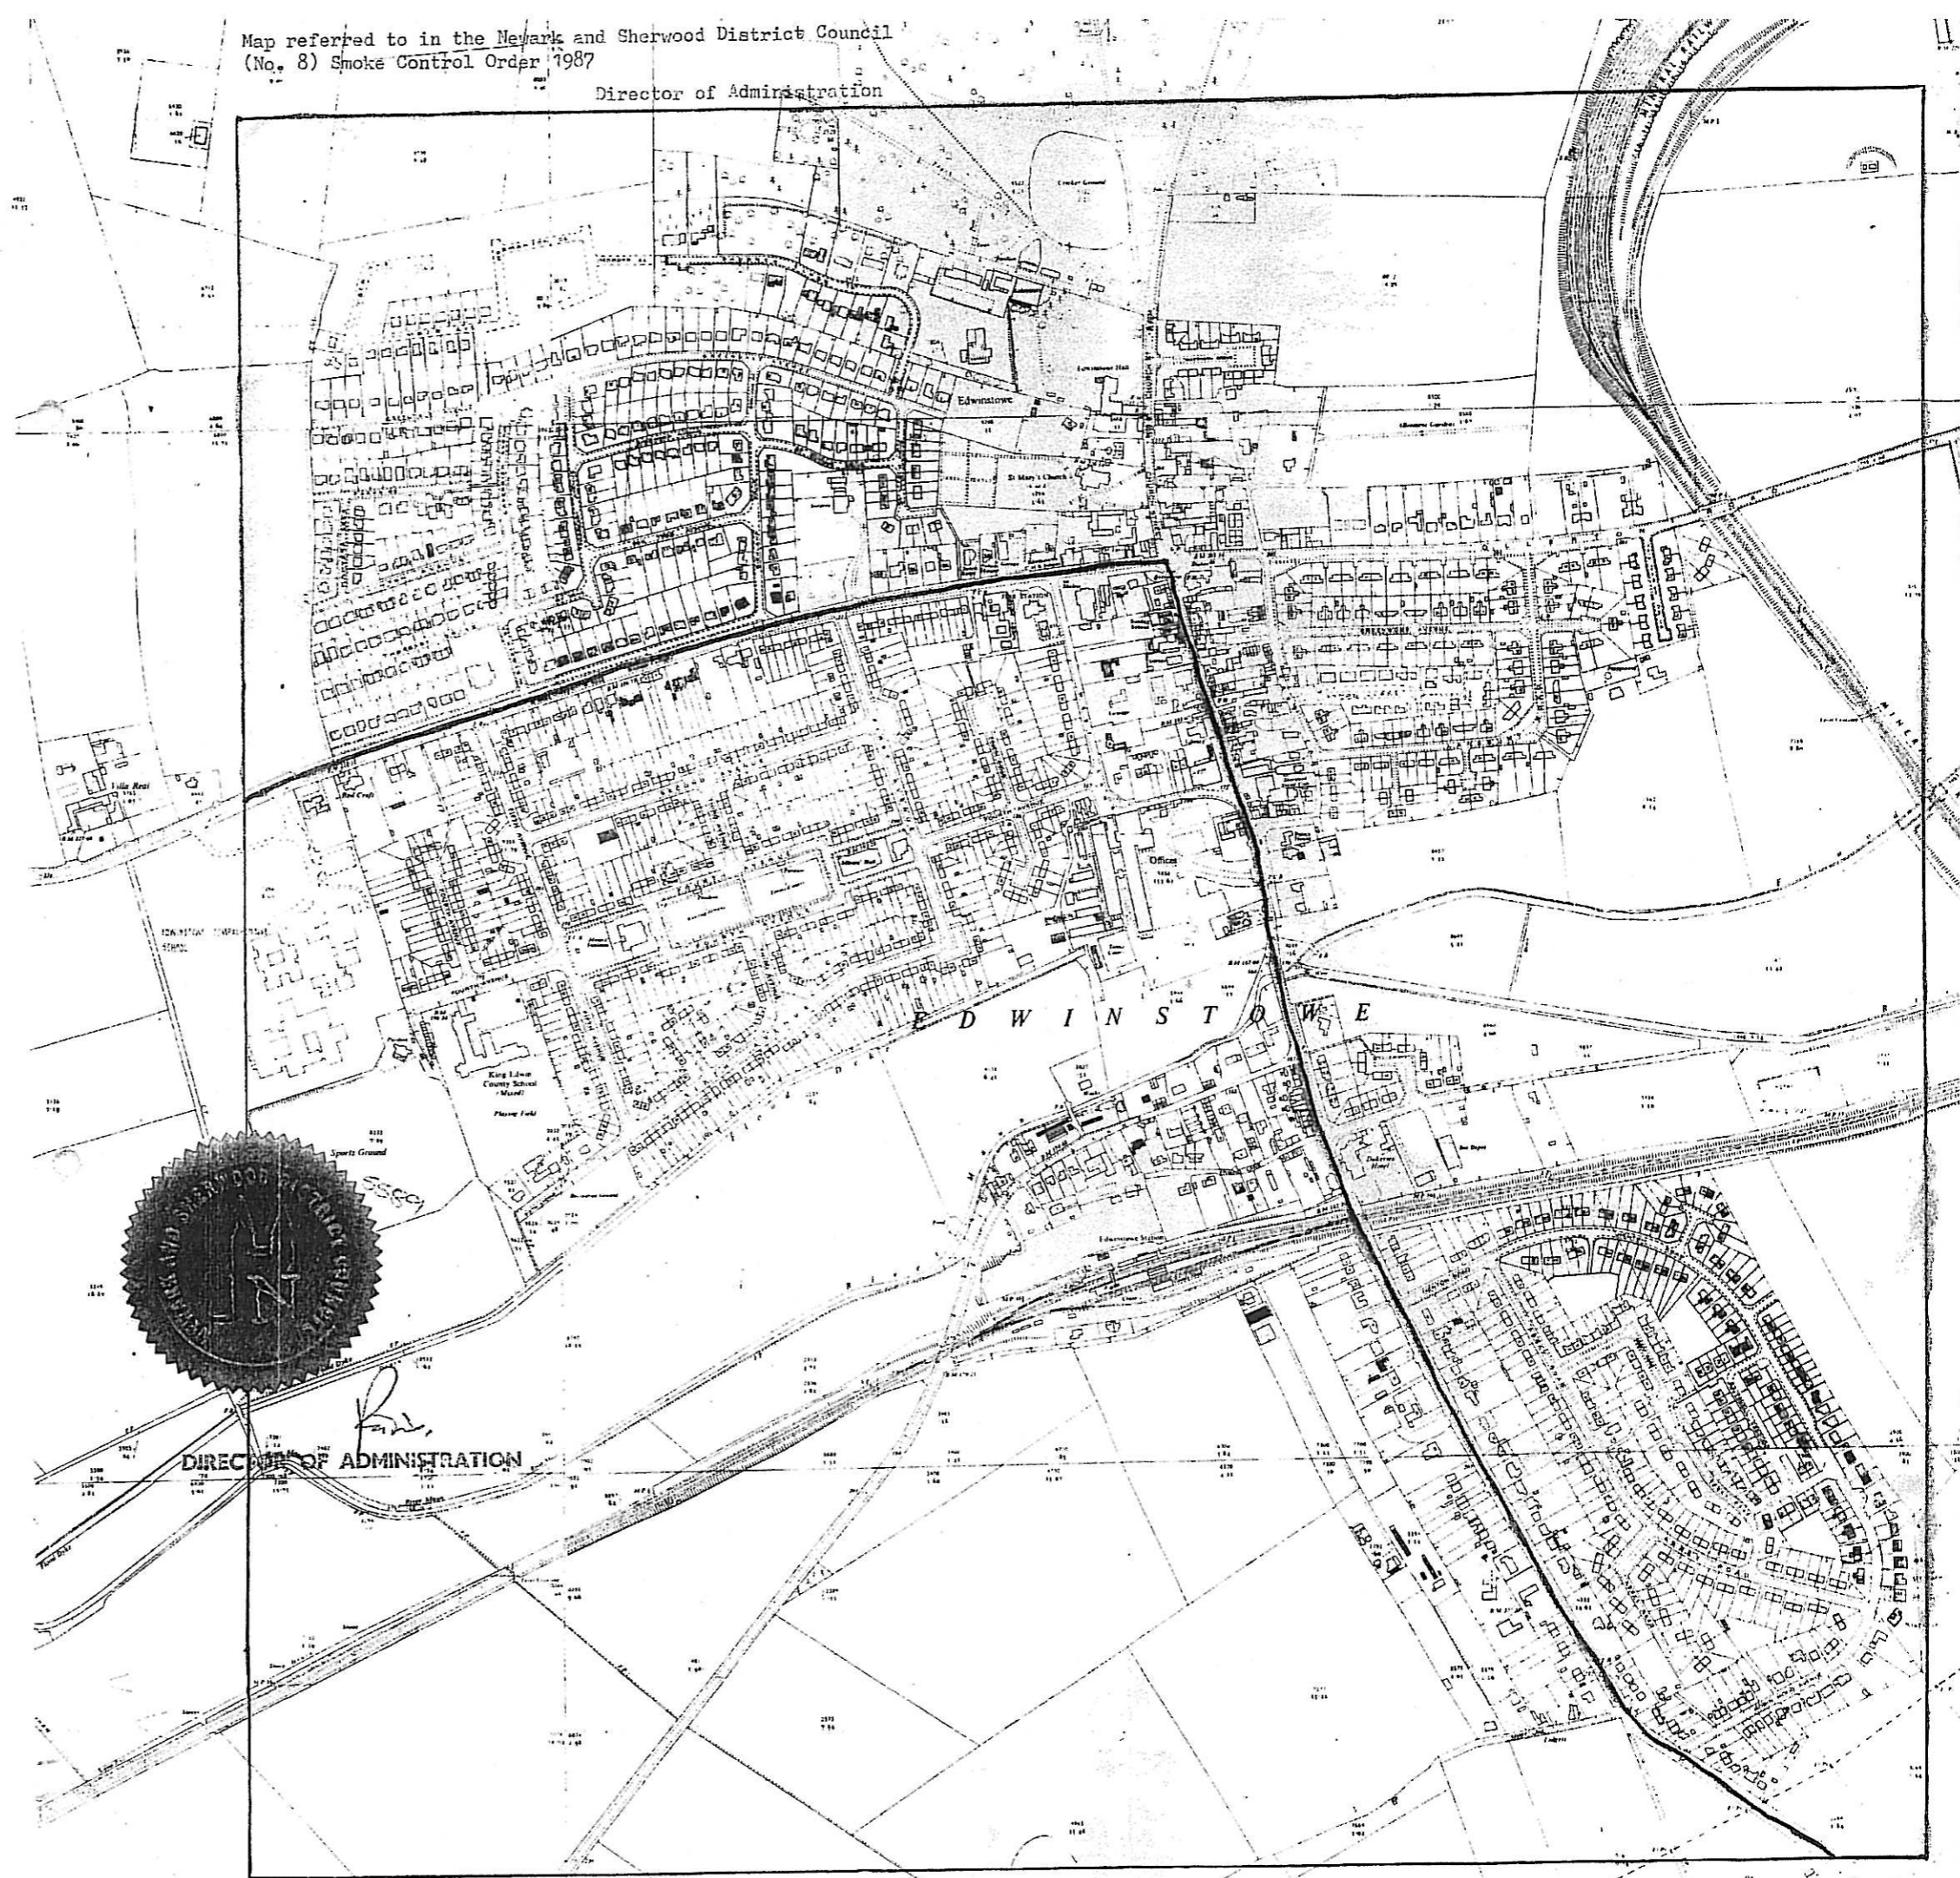

R. R.
DIRECTOR OF ADMINISTRATION

EDWINSTOWE